



SIEMENS

Profibus PA Device Integration



Mark McCormick
Product Manager Industrial
Communications



the power of **One**

PA device integration into a PLC system.

SIEMENS

Setting initial PA address

Adding PA device to Hardware Configuration of PLC

Adding PA Cyclic Data to PLC scan

Sending PA cyclic values to a Data Block


SIMATIC PDM - examples of use at commissioning stage.



the power of ne

Access points

SIEMENS

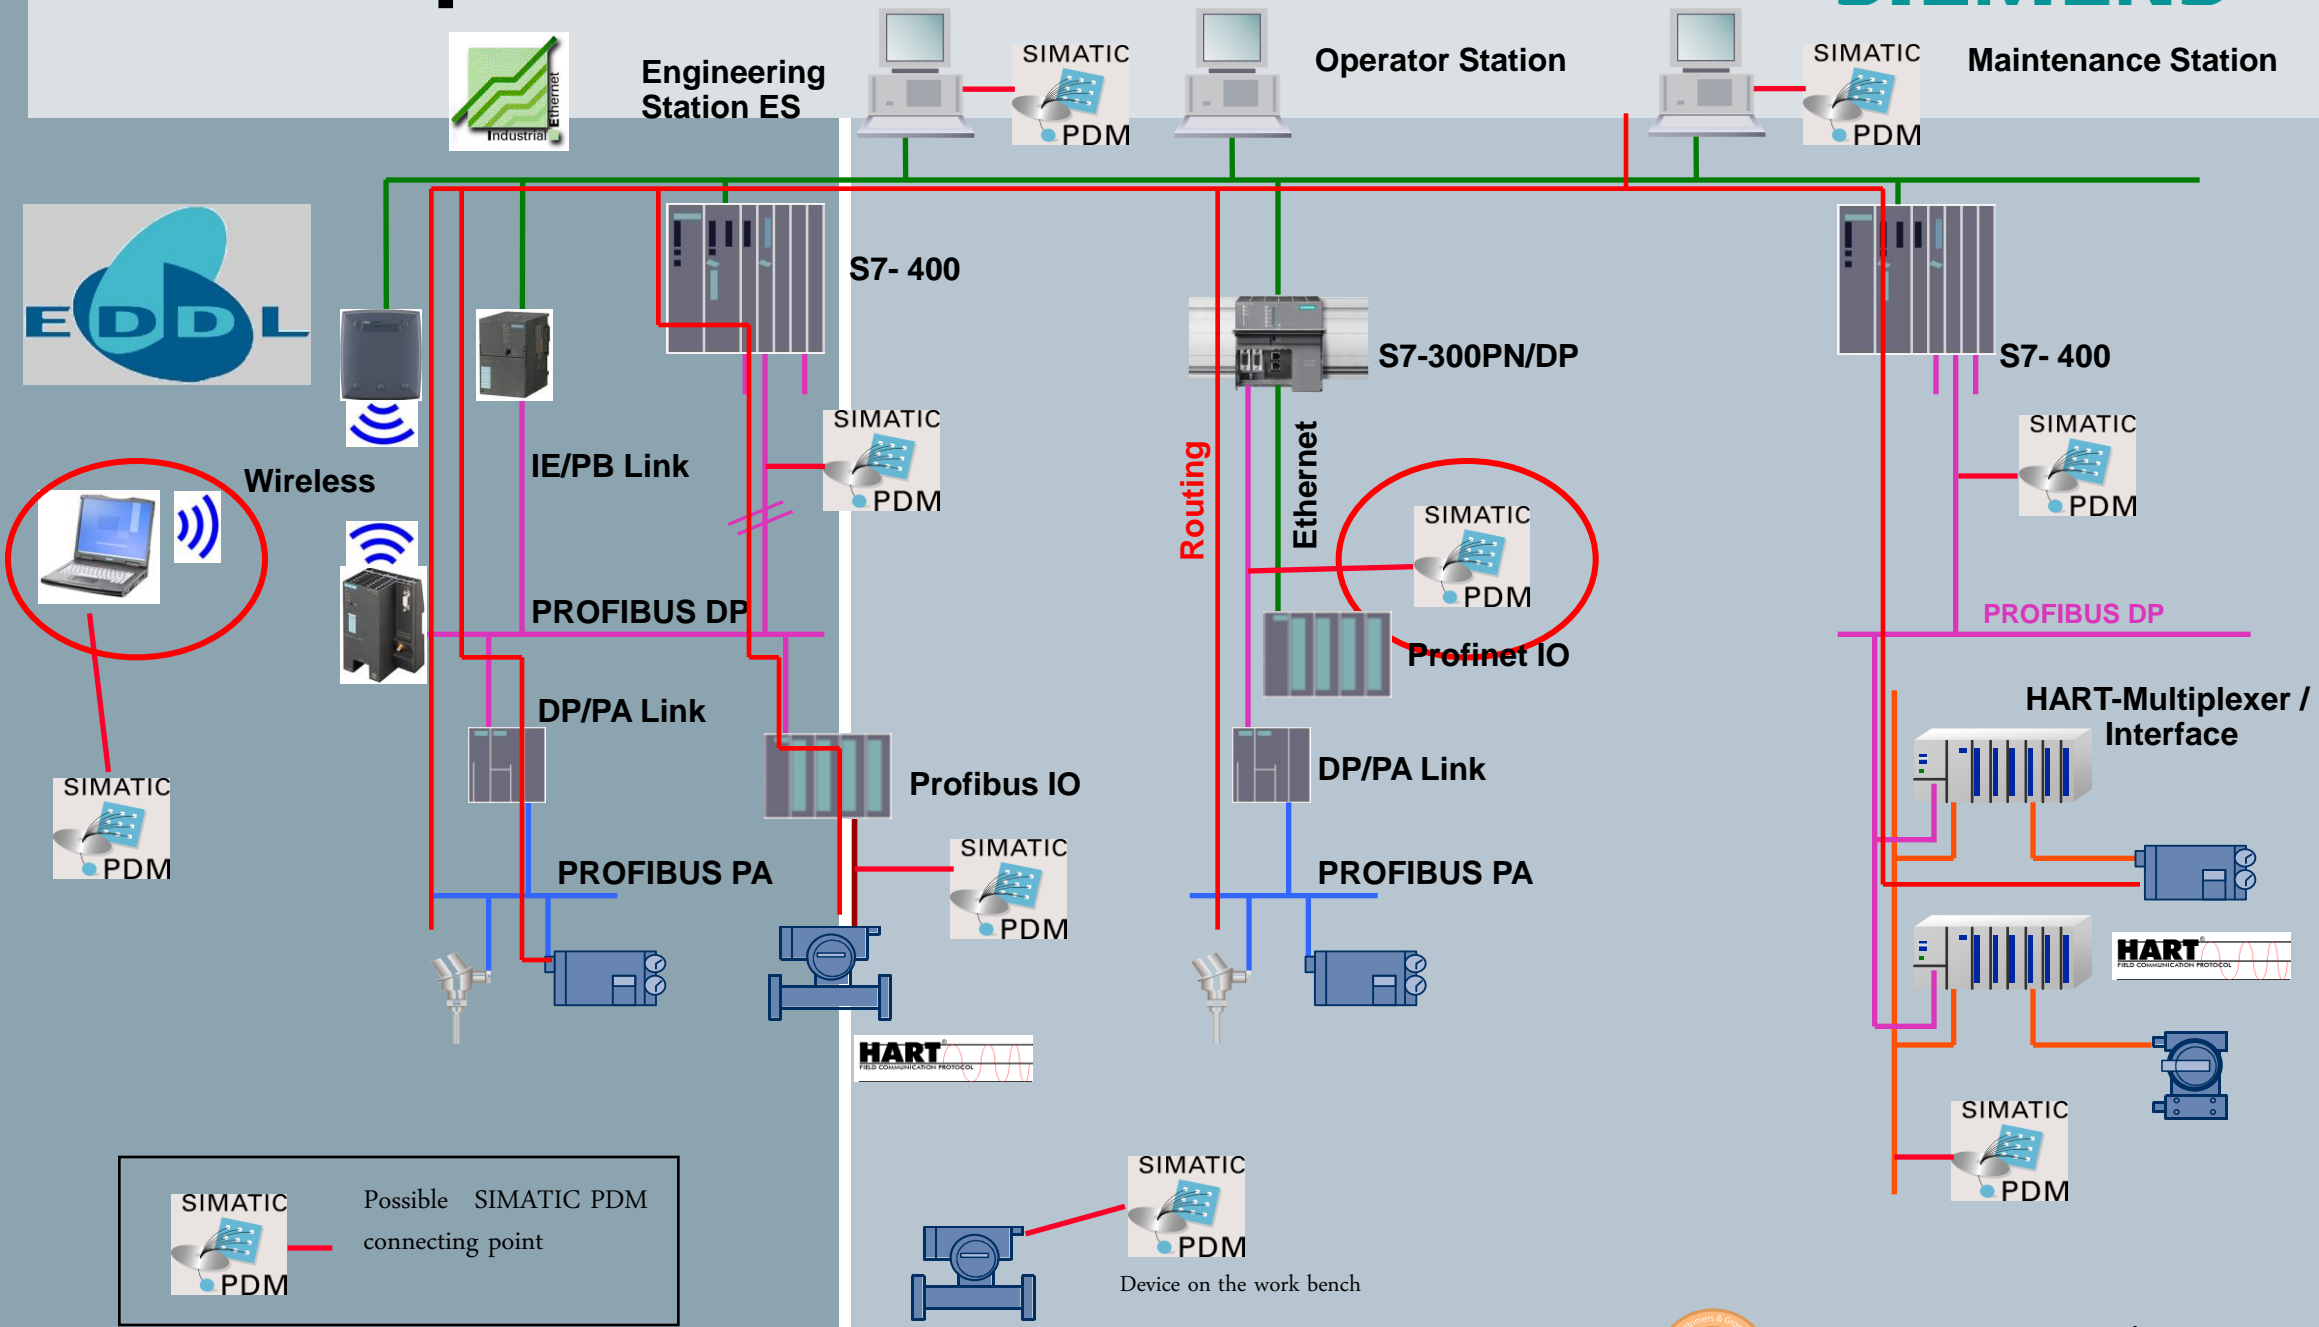

the power of **One**